


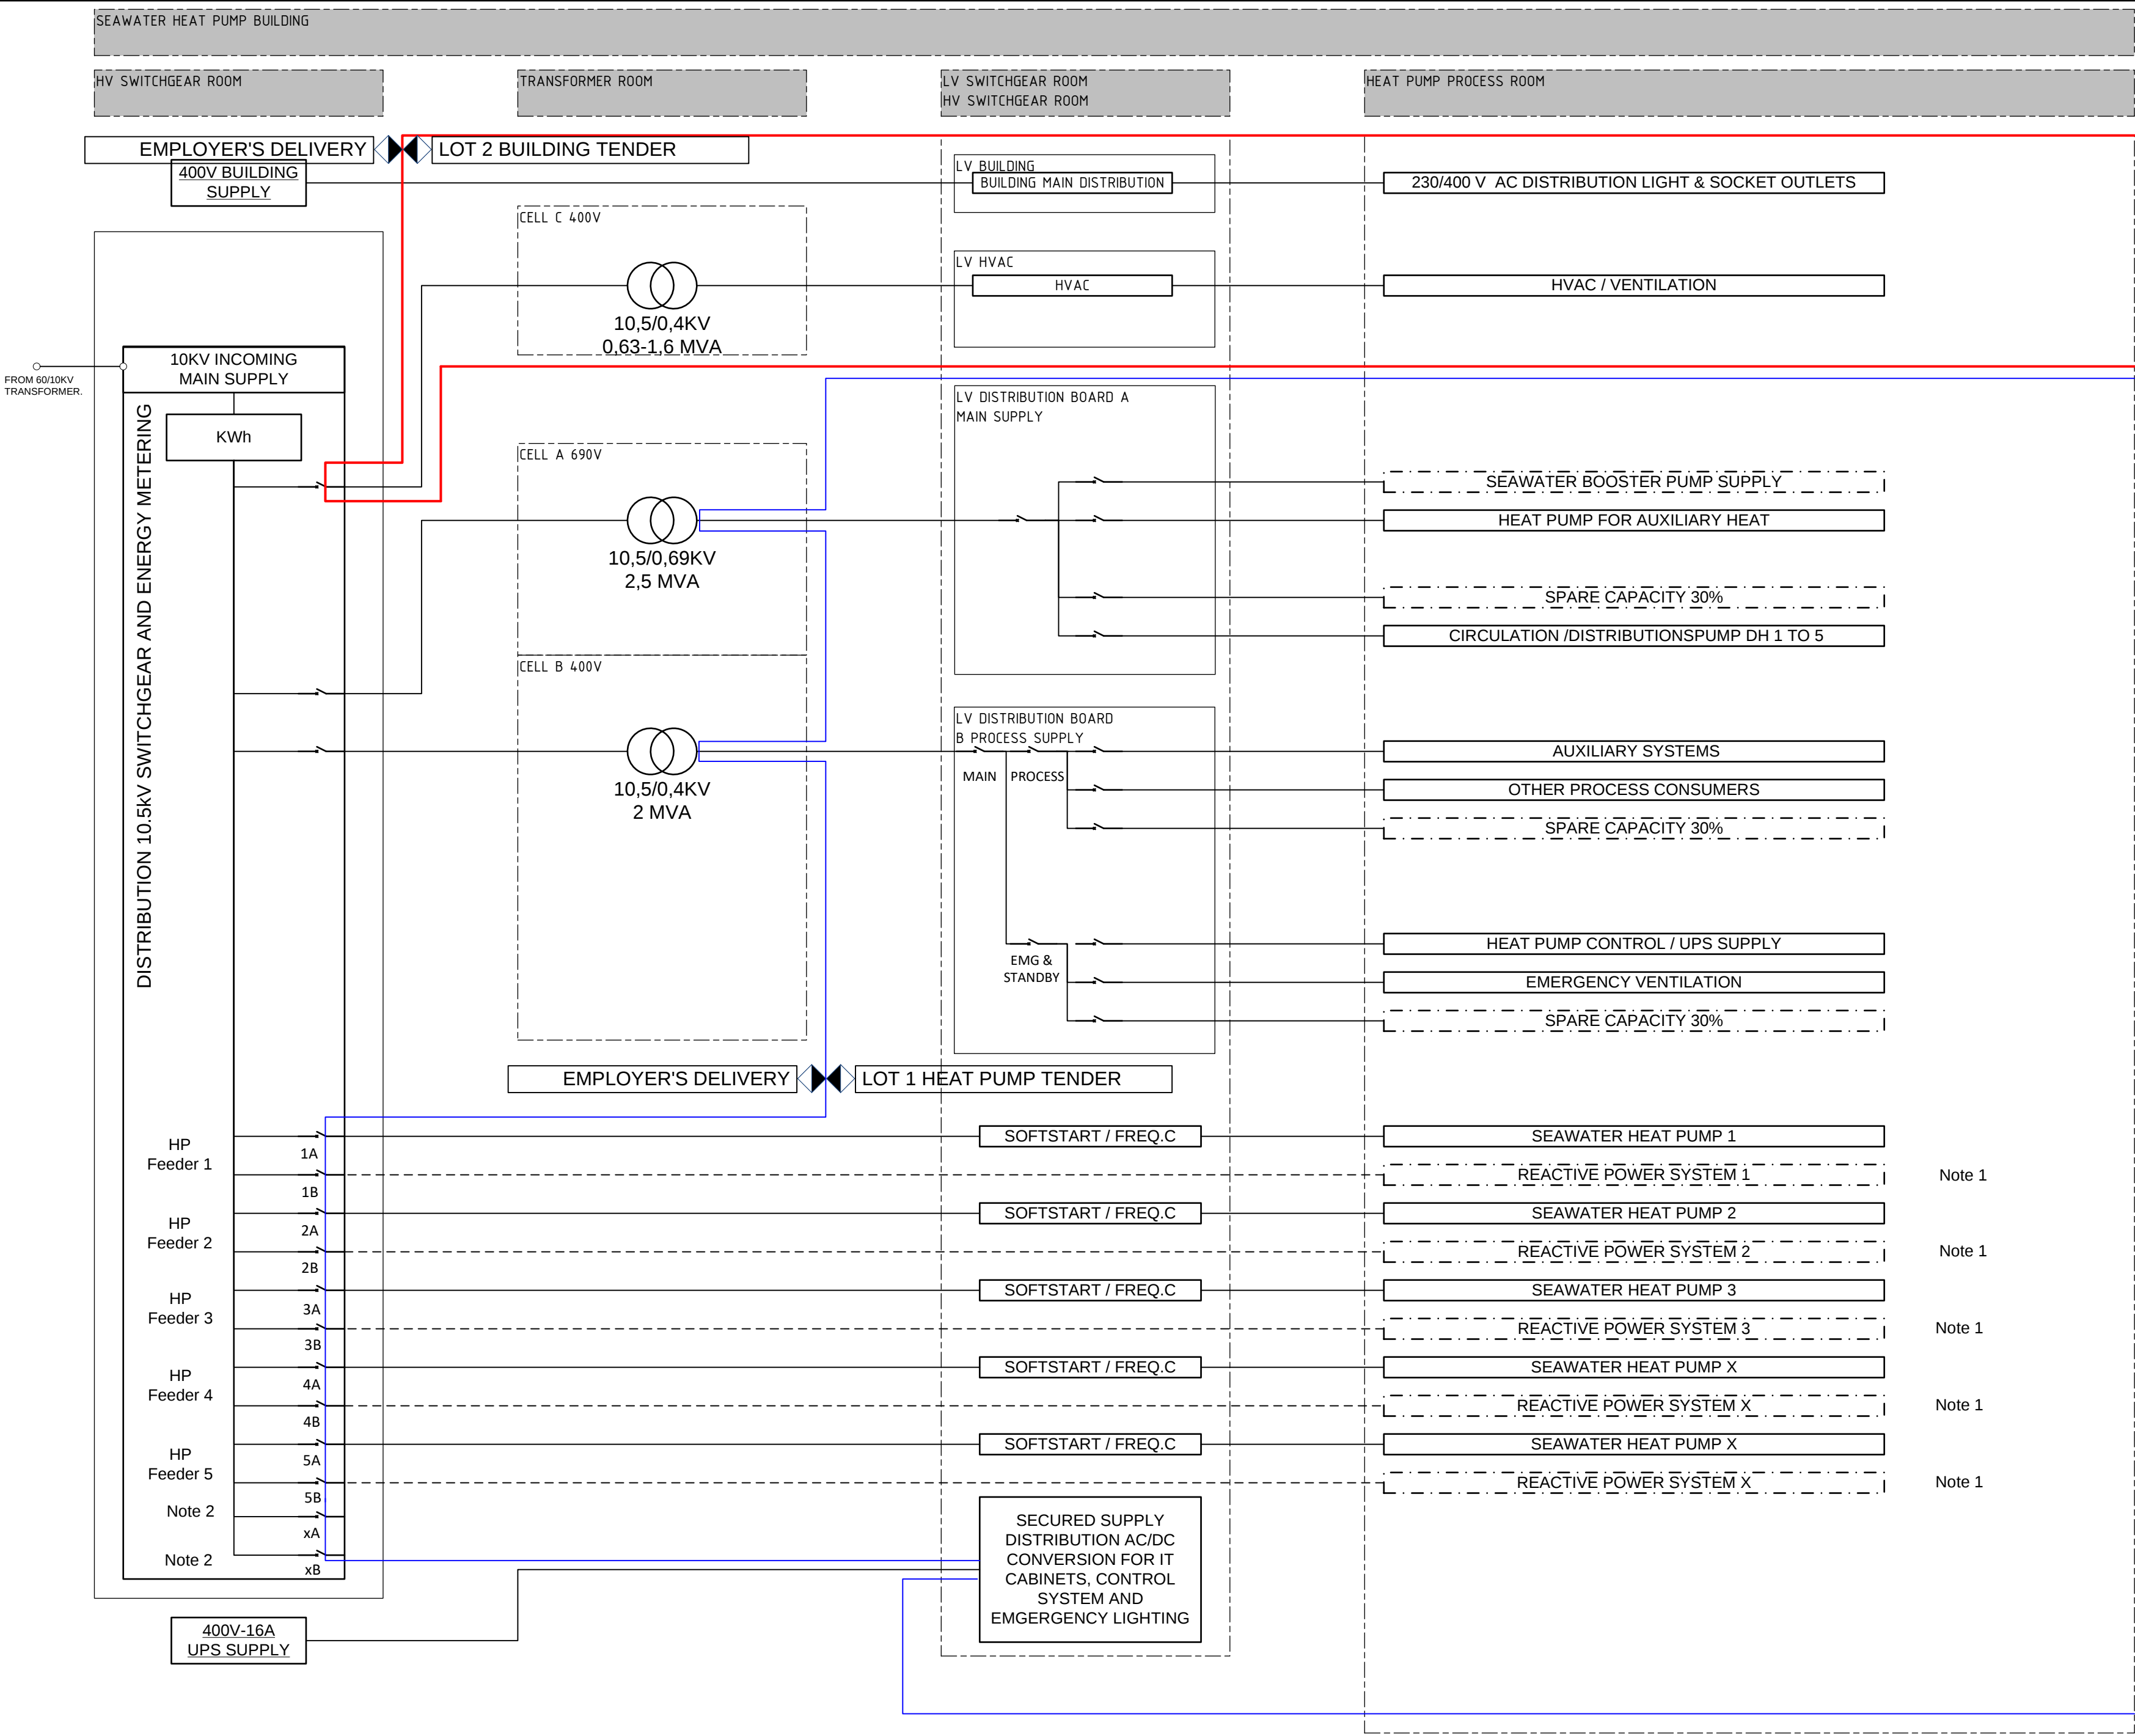

Notes

1. If use of soft starter, Reactive Power system shall be provided.

2. Additional Feeders for Heat Pumps.

References:

-